



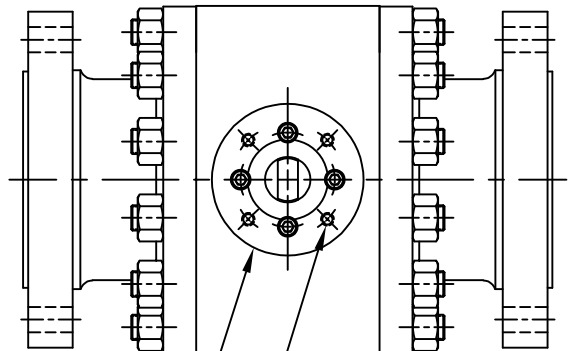

Q O.D. (J) SIZE K MTG. HOLES
ON L DIA. BOLT CIRCLE
MIN. TAP DEPTH M,
STRADDLE CENTERLINE

VALVE No.	MTG KIT	D	F	G	H	ISO	J	K
10F-T33-RF	AK-1650	1.81	12.25	2.749	1.498	F16	4	3/4-10
10F-T63-RF	AK-1650	1.81	12.25	2.749	1.498	F16	4	3/4-10
12F-T13-RF	AK-1650	1.81	13.25	2.749	1.498	F16	4	3/4-10
12F-T33-RF	AK-1650	1.81	13.25	2.749	1.498	F16	4	3/4-10
12F-T63-RF	AK-1900	1.81	13.88	2.749	1.498	F25	8	5/8-11

VALVE No.	L	M	P	Q
10F-T33-RF	6.500	1	1.56	8
10F-T63-RF	6.500	1	1.56	8
12F-T13-RF	6.500	1	1.56	8
12F-T33-RF	6.500	1	1.56	8
12F-T63-RF	10.000	1	1.56	11.88

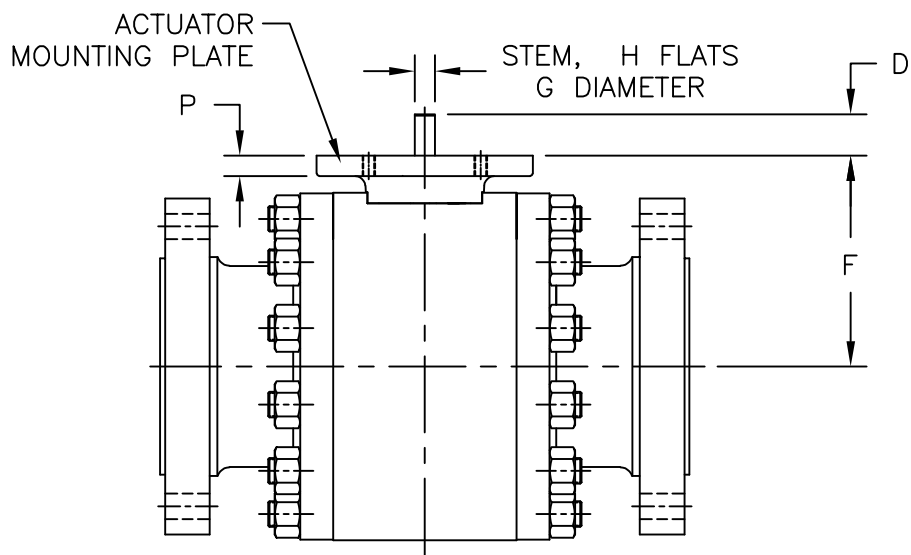

NOTES:

VALVE SHOWN IN CLOSED POSITION.

VALVE SHOWN "PREPPED FOR ACTUATOR".

MOUNTING PLATE KIT IS SOLD SEPARATELY
FOR VALVES NOT ALREADY PREPPED.

STEM MOVES UPWARD DURING A FIRE.
FIRE SAFETY DISTANCE BUILT IN
TO "D" DIMENSION.

OVERALL DIMENSIONS ARE AVAILABLE ON THE
CORRESPONDING CATALOG PAGES

DIMENSIONS ARE SHOWN ACCORDING TO THE BASE
VALVE No. AND APPLY TO ALL END CONNECTIONS



THIS DRAWING AND ALL OTHER INFORMATION CONTAINED HEREIN ARE THE PROPERTY OF BALON CORPORATION. IT IS LOANED TO YOUR FIRM FOR YOUR USE ONLY AND IS NOT TO BE REPRODUCED, COPIED, OR DISTRIBUTED IN ANY MANNER WITHOUT THE WRITTEN PERMISSION OF BALON CORPORATION. ANY REPRODUCTION OR DISTRIBUTION OF THIS DRAWING WITHOUT THE WRITTEN PERMISSION OF BALON CORPORATION IS PROHIBITED. BALON CORPORATION, 2300 S. DATE, OKLAHOMA CITY, OKLAHOMA 73129. © Balon Corp.

APPVD	ASSY	C
DL	CL	05-14-14
DATE:	BY	1000-E
6-26-25	CLL	
ACTUATOR INTERFACE-T SERIES TRUNNION	REV	ECN
10" 3-600 12" 150-600 BALL VALVES	B	
SCALE: NONE		